Anchor posts (P) require ≥ 14 for N3 provided. 8+2+4+4 = 18.

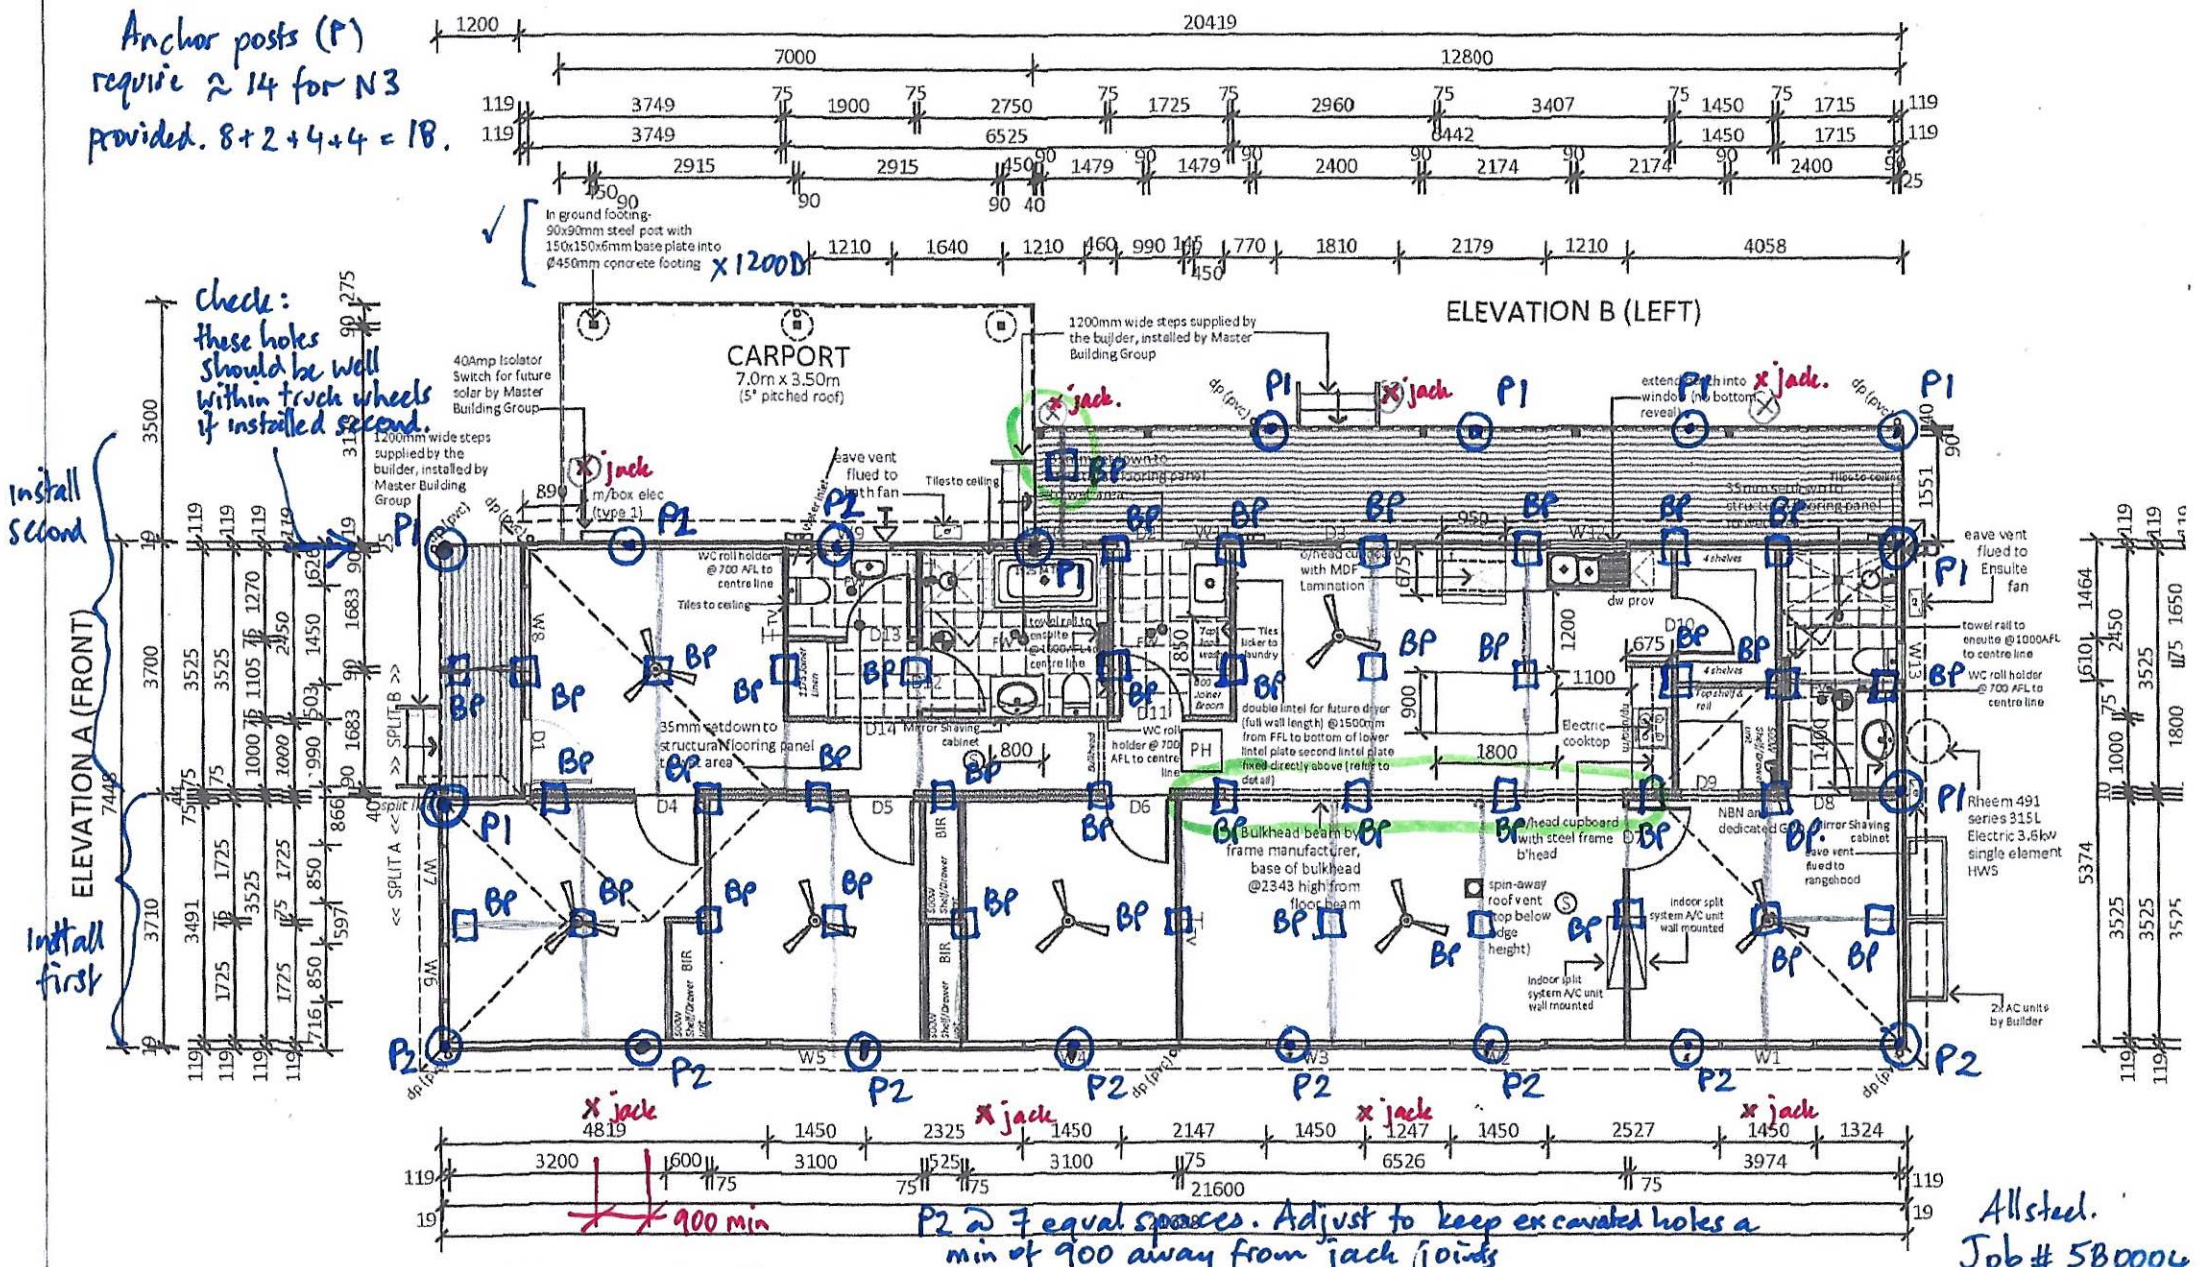

8 No off P1 (R) = 75x4 SHS steel post embedded into Ø450 x 900D footing (700 embed)

10 No off P2 (A) = 75x4 SHS steel post embedded into Ø450 x 1600D footing (1400 embed)

max 800 above GL

Note: check with Supaloc there is no net uplift from these int beams. If so P1 type footings with adj steel stump may be required in lieu of dry blocks in this area. Sim for deck beam at end.

Allsteel.
Job # 5B0004
Wilcannia NSW

Footing Prelims
SK2 Issue A
Nov 22

Scale 1:100